

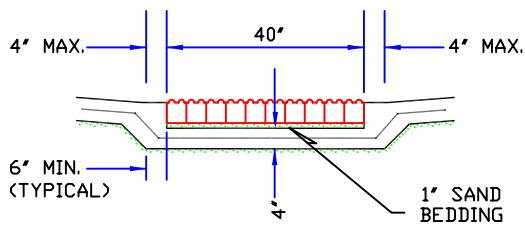


BRICK PAVERS SHALL BE 8"x 4"x 2-1/2" ANTIQUE RED PAVERS IN COLOR MEETING ADA SECTION 4.29.2. (WHITACRE GREER ANTIQUE RED SHADE NO. 32 OR APPROVED EQUAL). PAVERS SHALL HAVE DETECTABLE WARNING THAT CONSIST OF RAISED TRUNCATED DOMES WITH A DIA. OF 0.9 IN. (23MM), A HEIGHT OF NOMINAL 0.2 IN. (5MM) AND A CENTER TO CENTER SPACING OF NOMINAL 2.35 IN. (60MM).

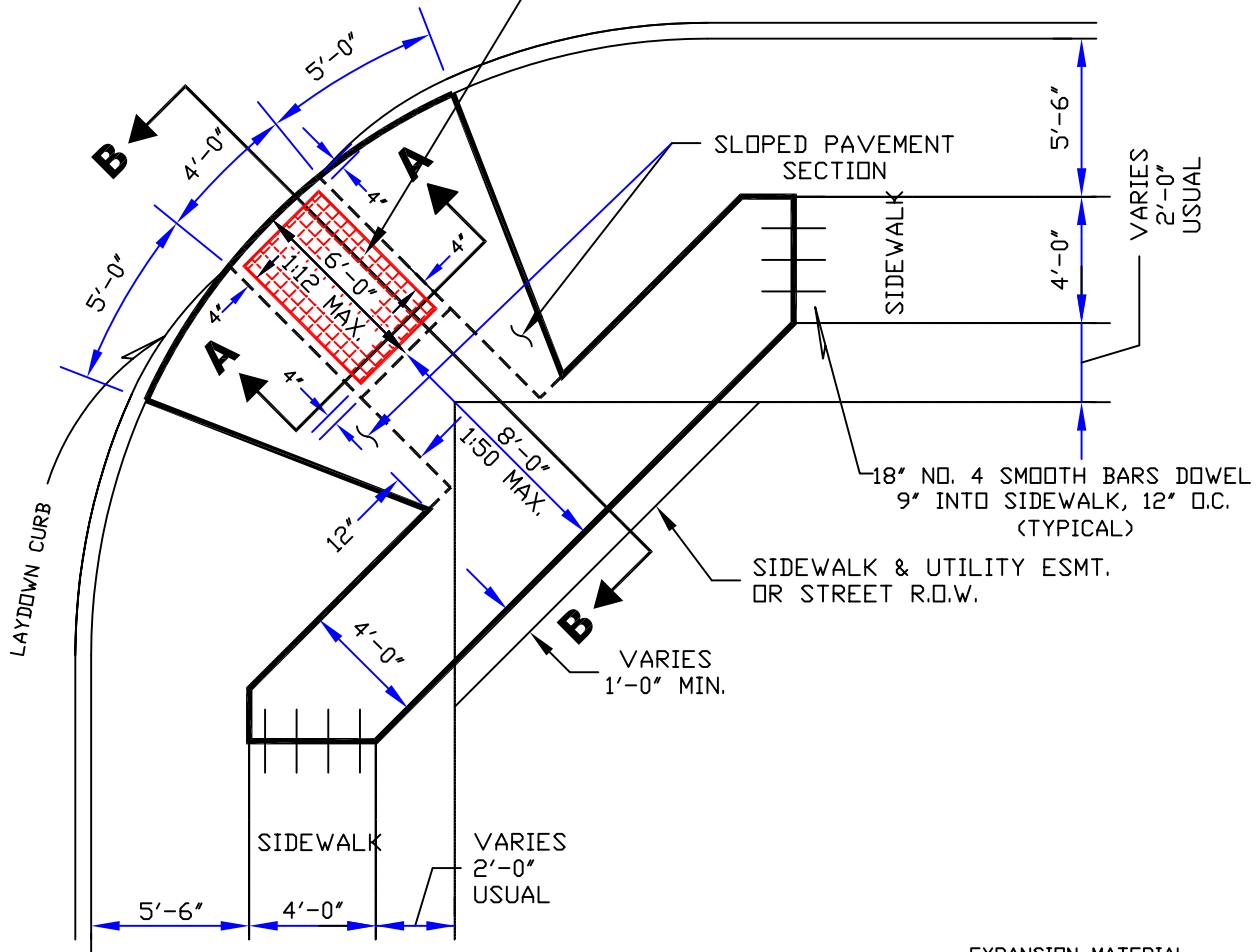

**SECTION A-A**

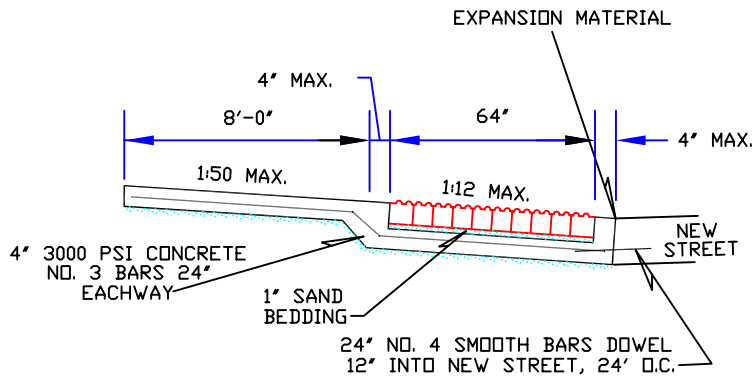

**SECTION B-B**

N. T. S.

**TYPICAL BARRIER FREE RAMP AT AN INTERSECTION WITH R.O.W. CORNER CLIP.**

**BARRIER FREE RAMP AT INTERSECTION**

**CITY OF FRISCO, TEXAS**

DATE: 10/02/03  
DRAWN BY: HTW  
APPROVED BY: FEJ

**FIGURE 1**

Technical drawing showing a cross-section of a curb and gutter detail. The drawing includes the following elements and dimensions:

- SAWCUT:** Indicated on the left side of the curb.
- LAYDOWN CURB:** Indicated on the left side of the curb.
- EXPANSION MATERIAL:** Indicated at the bottom right.
- EXIST. SIDEWALK:** Indicated at the bottom and right.
- REMOVE & REPLACE CURB AND GUTTER.** Indicated on the right side.
- SLOPED PAVEMENT SECTION:** Indicated on the right side.
- Dimensions:**
  - 5'-0" (multiple locations)
  - 4'-0" (multiple locations)
  - 4'-0" MIN.
  - 4'-0" MAX.
  - 1:20 MAX.
  - 1:50 MAX.
  - 1:12 MAX.
  - 18" (multiple locations)
  - 2'-0" USUAL
  - VARIES
- Notes:**
  - 18" NO. 4 SMOOTH BARS DOWEL INTO EXIST. SIDEWALK, 12" O.C. (TYPICAL)


## SECTION A-A

## SECTION B-B

FIGURE 2

## ALTERNATE BARRIER FREE RAMP AT AN INTERSECTION WITH NO R.O.W. CORNER CLIP.

BRICK PAVERS SHALL BE 8"x 4"x 2-1/2" ANTIQUE RED PAVERS IN COLOR MEETING ADA SECTION 4.29.2. (WHITACRE GREER ANTIQUE RED SHADE NO. 32 OR APPROVED EQUAL). PAVERS SHALL HAVE DETECTABLE WARNING THAT CONSIST OF RAISED TRUNCATED DOMES WITH A DIA. OF 0.9 IN. (23MM), A HEIGHT OF NOMINAL 0.2 IN. (5MM) AND A CENTER TO CENTER SPACING OF NOMINAL 2.35 IN. (60MM).

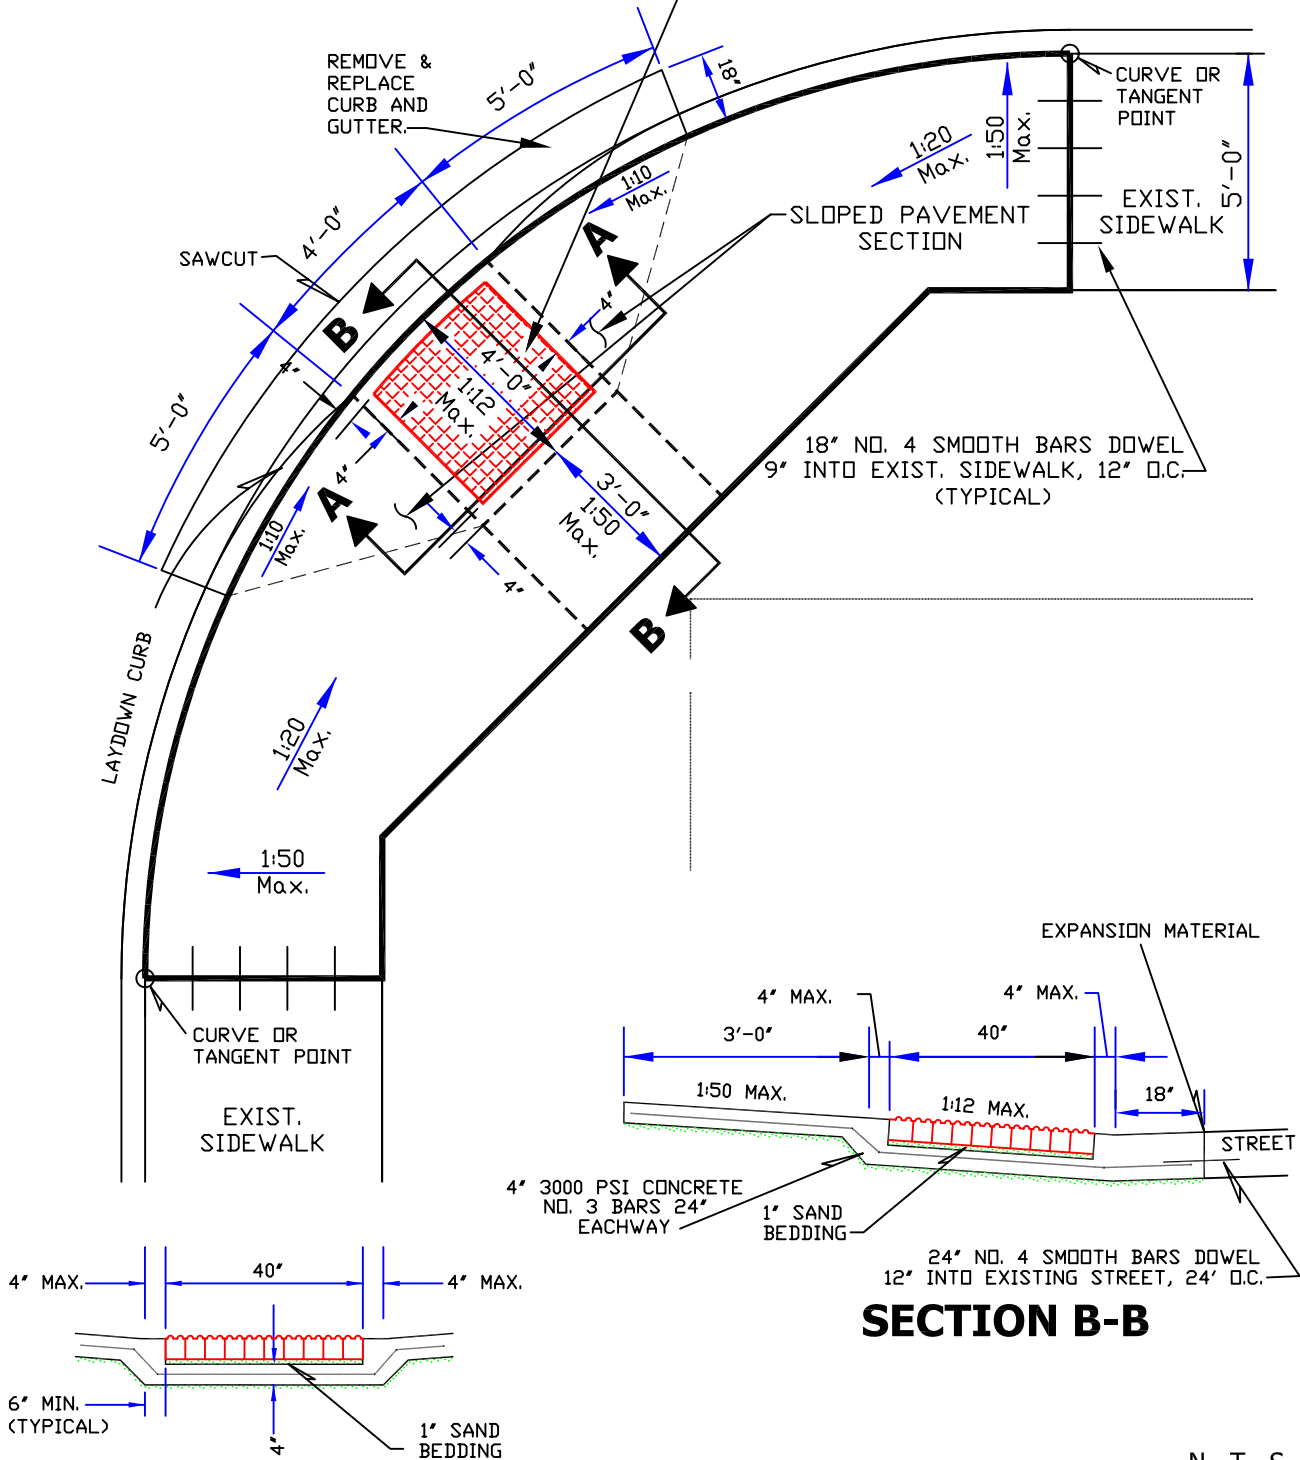

## SECTION A-A

**TYPICAL BARRIER FREE RAMP  
AT AN INTERSECTION WITH  
SIDEWALK ADJACENT TO CURB.**

## SECTION B-B

N . T . S.

**BARRIER FREE RAMP  
SIDEWALK AT CURB**

 **CITY OF FRISCO, TEXAS**

DATE: 10/02/03  
DRAWN BY: HTW  
APPROVED BY: FEJ

**FIGURE 3**

Diagram illustrating the cross-section of a curb and gutter assembly, showing dimensions and reinforcement details:

- Dimensions:**
  - Top width segments: 3'-0", 4'-0", 3'-0"
  - Top width segments: 4", 4", 4"
  - Vertical height: 5'-6"
  - Vertical height: 4'-0"
  - Vertical height: 12"
  - Vertical height: 4'-8" MAX
  - Vertical height: 1'-2" MAX
  - Vertical height: 1'-50 MAX
- Labels:**
  - SLOPED PAVEMENT SECTION
  - LAYDOWN CURB
  - SIDEWALK
  - 18" NO. 4 SMOOTH BARS DOWEL 9" INTO SIDEWALK, 12" O.C. (TYPICAL)
- Reinforcement:**
  - 18" NO. 4 SMOOTH BARS DOWEL 9" INTO SIDEWALK, 12" O.C. (TYPICAL)



FIGURE 4

4" MAX.

40°

4" MAX.

1" SAND BEDDING

4"

4"

3000 PSI CONCRETE  
NO. 3 BARS 24"  
EACHWAY

[illegible]

## FIGURE 5